




HYDROFIRE ΕΠΕ

Buildings - Industry - Marine – Waterworks
 END OF AG. PANTELEIMONOS Str. (ELEONAS)
 GR-12241 EGALEO,
 Tel.: +30 210 3412 749-750 Fax: +30 210 3412 406
www.hydrofire.gr, email: info@hydrofire.gr



Victaulic® FireLock™ Series FL-ECLH/SW Extended Coverage, Quick Response Horizontal Sidewall and Recessed Horizontal Sidewall Sprinklers K5.6 (8.1), K8.0 (11.5)



1.0 PRODUCT DESCRIPTION

EXTENDED COVERAGE QUICK RESPONSE HORIZONTAL SIDEWALL SPRINKLERS		
SIN	V2758	V3416
ORIENTATION	HSW	HSW
K-FACTOR ¹	5.6 Imp./8.1 S.I.	8.0 Imp./11.5 S.I.
CONNECTION	½" NPT/15 mm	¾" NPT/20 mm
MAX. WORKING PRESSURE	175 psi (1200 kPa)	175 psi (1200 kPa)
GLOBE RE-DESIGNATION	–	–
GLOBE EQUIVALENT	GL5628	GL8129

EXTENDED COVERAGE QUICK RESPONSE RECESSED HORIZONTAL SIDEWALL SPRINKLERS		
SIN	V2758	V3416
ORIENTATION	HSW	HSW
K-FACTOR ¹	5.6 Imp./8.1 S.I.	8.0 Imp./11.5 S.I.
CONNECTION	½" NPT/15 mm	¾" NPT/20 mm
MAX. WORKING PRESSURE	175 psi (1200 kPa)	175 psi (1200 kPa)
ESCUTCHEON	Recessed	Recessed
GLOBE RE-DESIGNATION	–	–
GLOBE EQUIVALENT	GL5628	GL8129

AVAILABLE WRENCHES				
SPRINKLER	V27 Recessed	V27 Open End	V34 Recessed	V34 Open End
SIDEWALL	■	■	■	■

Factory Hydrostatic Test: 100% @ 500 psi/3447 kPa/34 bar

Min. Operating Pressure: UL/FM: 7psi/48 kPa/5 bar

Temperature Rating: See tables in section 2.0

¹ For K-Factor when pressure is measured in bar, multiply S.I. units by 10.0.

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.





HYDROFIRE ΕΠΕ

Buildings - Industry - Marine – Waterworks

END OF AG. PANTELEIMONOS Str. (ELEONAS)

GR-12241 EGALEO,

Tel.: +30 210 3412 749-750 Fax: +30 210 3412 406

www.hydrofire.gr, email: info@hydrofire.gr



victaulic.com

2.0 CERTIFICATION/LISTINGS



SIN			V2758									
Nominal K Factor Imperial			5.6									
Nominal K Factor S.I. ²			8.1									
Installation Type			Horizontal Sidewall				Recessed Horizontal Sidewall				Minimum Spacing Ft m	
Max. Coverage Area Width x Length Ft x Ft m x m	Listing Agency	Top of Deflector Ceiling in mm	Response	Flow GPM L/min	Pressure PSI kPa	Approved Temperature Ratings F°/C°	Response	Adjustment in mm	Flow GPM L/min	Pressure PSI kPa		Approved Temperature Ratings F°/C°
16 x 16 4.9 x 4.9	cULus	4 – 6 100 – 150	QR	26 98	21.5 148	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	26 98	21.5 148	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	8 2.4
	cULus	6 – 12 150 – 300	QR	26 98	21.5 148	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	26 98	21.5 148	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	FM	See FM Datasheet 2-0	QR	26 98	21.5 148	135°F/57°C 155°F/68°C 175°F/79°C	QR	½ 15	26 98	22 152	135°F/57°C 155°F/68°C 175°F/79°C	
16 x 18 4.9 x 5.5	cULus	4 – 6 100 – 150	QR	29 110	26.8 185	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	29 110	26.8 185	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	cULus	6 – 12 150 – 300	QR	29 110	27 186	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	29 110	27 186	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	FM	See FM Datasheet 2-0	QR	30 115	29 200	135°F/57°C 155°F/68°C	QR	½ 15	30 115	29 200	135°F/57°C 155°F/68°C	
16 x 20 4.9 x 6.1	cULus	4 – 6 100 – 150	QR	32 121	33 228	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	32 121	33 228	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	cULus	6 – 12 150 – 300	QR	32 121	33 228	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	32 121	33 228	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	FM	See FM Datasheet 2-0	QR	33 125	35 241	135°F/57°C 155°F/68°C	QR	1/2 15	33 125	35 241	135°F/57°C 155°F/68°C	
16 x 22 4.9 x 6.7	cULus	4 – 6 100 – 150	QR	36 148	41.3 285	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	36 148	41.3 285	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	cULus	6 – 12 150 – 300	QR	36 148	41.3 285	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	36 148	41.3 285	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
16 x 24 4.9 x 7.3	cULus	4 – 6 100 – 150	QR	39 148	49 338	135°F/57°C 175°F/79°C	QR	½ and ¾ 15 and 20	39 148	49 338	135°F/57°C 175°F/79°C	
	cULus	6 – 10 150 – 250	QR	40 151	51 352	135°F/57°C 175°F/79°C	QR	½ and ¾ 15 and 20	40 151	51 352	135°F/57°C 175°F/79°C	

² For K-Factor when pressure is measured in bar, multiply S.I. units by 10.0.

NOTES

- Listings and approval as of printing.
- See FM Datasheet 2-0 for vertically locating sprinklers.



HYDROFIRE ΕΠΕ

Buildings - Industry - Marine – Waterworks

END OF AG. PANTELEIMONOS Str. (ELEONAS)

GR-12241 EGALEO,

Tel.: +30 210 3412 749-750 Fax: +30 210 3412 406

www.hydrofire.gr, email: info@hydrofire.gr



victaulic.com

2.0 CERTIFICATION/LISTINGS (CONTINUED)



SIN			V3416									
Nominal K Factor Imperial			8.0									
Nominal K Factor S.I. ²			11.5									
Installation Type			Horizontal Sidewall				Recessed Horizontal Sidewall				Minimum Spacing	
Max. Coverage Area Width x Length	Listing Agency	Top of Deflector Ceiling	Flow	Pressure	Approved Temperature Ratings	Response	Adjustment	Flow	Pressure	Approved Temperature Ratings		
Ft x Ft m x m		in mm	GPM L/min	PSI kPa	F°/C°		in mm	GPM L/min	PSI kPa	F°/C°	Ft m	
16 x 16 4.9 x 4.9	cULus	4 – 6 100 – 150	QR	26 98	10.6 73	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	26 98	10.6 73	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	8 2.4
	cULus	6 – 12 150 – 300	QR	28 106	12.3 85	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	28 106	12.3 85	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	FM	See FM Datasheet 2 – 0	QR	32 121	16 110	135°F/57°C	QR	½ 15	32 121	16 110	135°F/57°C	
	CCC	Applicable Local Stan- dard	QR	Applicable Local Standard		155°F/68°C	QR	½ and ¾ 15 and 20	Applicable Local Standard		155°F/68°C	
16 x 18 4.9 x 5.5	cULus	4 – 6 100 – 150	QR	29 110	13.2 91	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	29 110	13.2 91	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	cULus	6 – 12 150 – 300	QR	33 125	17.1 118	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	33 125	17.1 118	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	FM	See FM Datasheet 2 – 0	QR	36 136	20 140	135°F/57°C	QR	½ 15	36 136	20 140	135°F/57°C	
	CCC	Applicable Local Stan- dard	QR	Applicable Local Standard		155°F/68°C	QR	½ and ¾ 15 and 20	Applicable Local Standard		155°F/68°C	
16 x 20 4.9 x 6.1	cULus	4 – 6 100 – 150	QR	32 121	16 110	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	32 121	16 110	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	cULus	6 – 12 150 – 300	QR	35 132	19.2 132	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	QR	½ and ¾ 15 and 20	35 132	19.2 132	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	
	FM	See FM Datasheet 2 – 0	QR	40 151	25 170	135°F/57°C	QR	½ 15	40 151	25 170	135°F/57°C	
	CCC	Applicable Local Stan- dard	QR	Applicable Local Standard		155°F/68°C	QR	½ and ¾ 15 and 20	Applicable Local Standard		155°F/68°C	

² For K-Factor when pressure is measured in bar, multiply S.I. units by 10.0.

NOTES

- Listings and approval as of printing.
- See FM Datasheet 2-0 for vertically locating sprinklers.



HYDROFIRE ΕΠΕ

Buildings - Industry - Marine – Waterworks

END OF AG. PANTELEIMONOS Str. (ELEONAS)

GR-12241 EGALEO,

Tel.: +30 210 3412 749-750 Fax: +30 210 3412 406

www.hydrofire.gr, email: info@hydrofire.gr



victaulic.com

2.0 CERTIFICATION/LISTINGS (CONTINUED)



SIN			V3416										
Nominal K Factor Imperial			8.0										
Nominal K Factor S.I. ²			11.5										
Installation Type			Horizontal Sidewall					Recessed Horizontal Sidewall					Minimum Spacing
Max. Coverage Area Width x Length	Listing Agency	Top of Deflector Ceiling	Response	Flow		Approved Temperature Ratings	Response	Adjustment	Flow		Approved Temperature Ratings		
				GPM	PSI				GPM	PSI			
Ft x Ft m x m		in mm		L/min	kPa	F°/C°		in mm	L/min	kPa	F°/C°	Ft m	
16 x 22 4.9 x 6.1	cULus	4 – 6 100 – 150	QR	36 136	20.3 140	135°F/57°C 155°F/68°C 175°F/79°C	QR	½ and ¾ 15 and 20	36 136	20.3 140	135°F/57°C 155°F/68°C 175°F/79°C	8 2.4	
	cULus	6 – 12 150 – 300	QR	36 136	20.3 140	135°F/57°C	QR	½ and ¾ 15 and 20	36 136	20.3 140	135°F/57°C		
	FM	See FM Datasheet 2 – 0	QR	44 167	30.3 209	135°F/57°C 155°F/68°C	QR SR	½ 15	44 167	30.3 209	135°F/57°C 155°F/68°C		
	CCC	Applicable Local Stan- dard	QR	Applicable Local Standard		155°F/68°C	QR	½ and ¾ 15 and 20	Applicable Local Standard		155°F/68°C		
16 x 24 4.9 x 7.3	cULus	4 – 6 100 – 150	QR	39 148	23.8 164	135°F/57°C 175°F/79°C	QR	½ and ¾ 15 and 20	39 148	23.8 164	135°F/57°C 175°F/79°C		
	cULus	6 – 12 150 – 300	QR	41 155	26.3 181	135°F/57°C 175°F/79°C	QR	½ and ¾ 15 and 20	41 155	26.3 181	135°F/57°C 175°F/79°C		
	FM	See FM Datasheet 2 – 0	QR	48 182	36 250	135°F/57°C 155°F/68°C	QR SR	½ 15	48 182	36 250	135°F/57°C 155°F/68°C		
	CCC	Applicable Local Stan- dard	QR	Applicable Local Standard		155°F/68°C	QR	½ and ¾ 15 and 20	Applicable Local Standard		155°F/68°C		

² For K-Factor when pressure is measured in bar, multiply S.I. units by 10.0.

NOTES

- Listings and approval as of printing.
- See FM Datasheet 2-0 for vertically locating sprinklers.



HYDROFIRE ΕΠΕ

Buildings - Industry - Marine – Waterworks
END OF AG. PANTELEIMONOS Str. (ELEONAS)
GR-12241 EGALEO,

Tel.: +30 210 3412 749-750 Fax: +30 210 3412 406
www.hydrofire.gr, email: info@hydrofire.gr



victaulic.com

3.0 SPECIFICATIONS – MATERIAL

Deflector: Bronze

Bulb Nominal Diameter: 3.0mm

Load Screw: Bronze

Pip Cap: Bronze

Spring Seal Assembly: PTFE coated Beryllium nickel alloy

Frame: Brass

Lodgement Spring: Stainless Steel

Installation Wrench: Ductile iron

Sprinkler Frame Finishes:

- Plain brass
- Chrome plated
- White polyester painted^{3, 4}
- Flat black polyester painted^{3, 4}
- Custom polyester painted^{3, 4}
- VC-250⁵


³ Not available on the Intermediate Level Style Pendant.

⁴ UL Listed for corrosion resistance.


⁵ UL Listed and FM Approved for corrosion resistance.

NOTE

- For cabinets and other accessories refer to separate sheet.

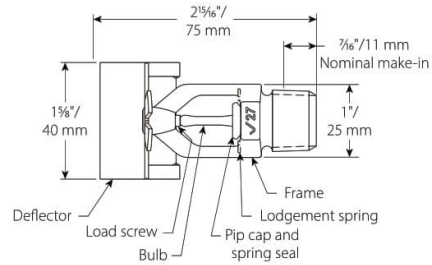

V2758

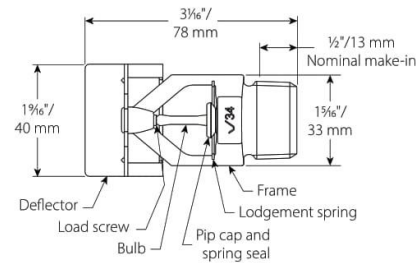

V3416



HYDROFIRE ΕΠΕ

Buildings - Industry - Marine – Waterworks

END OF AG. PANTELEIMONOS Str. (ELEONAS)

GR-12241 EGALEO,


Tel.: +30 210 3412 749-750 Fax: +30 210 3412 406

www.hydrofire.gr, email: info@hydrofire.gr




victaulic.com

4.0 DIMENSIONS

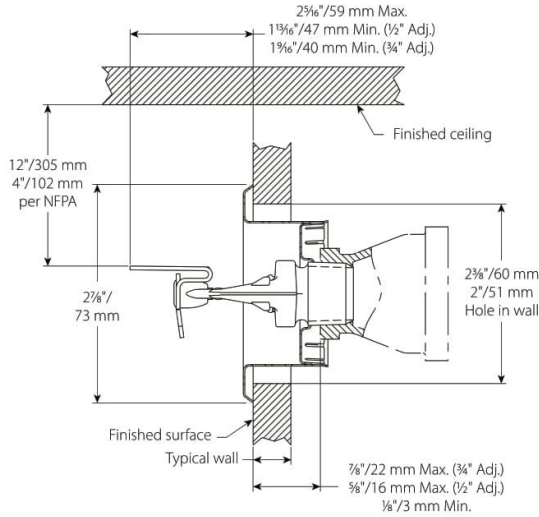

V2758

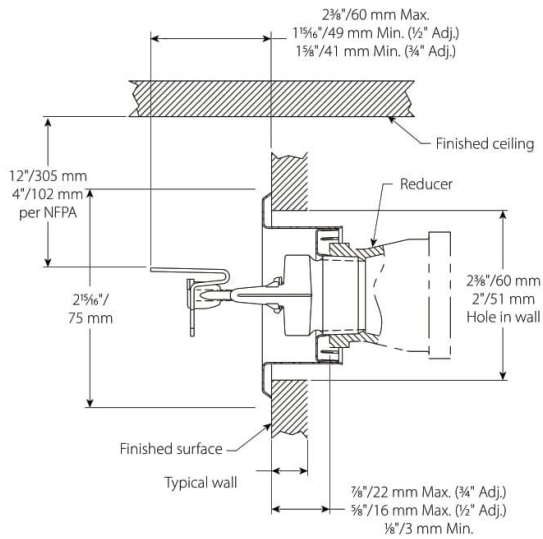

V3416

5.0 PERFORMANCE

Sprinkler is to be installed and designed as per NFPA, FM Datasheets, or any local standards.








HYDROFIRE ΕΠΕ

Buildings - Industry - Marine – Waterworks
END OF AG. PANTELEIMONOS Str. (ELEONAS)
GR-12241 EGALEO,
Tel.: +30 210 3412 749-750 Fax: +30 210 3412 406
www.hydrofire.gr, email: info@hydrofire.gr



victaulic.com

6.0 NOTIFICATIONS

⚠ WARNING	
    	<ul style="list-style-type: none"> • Read and understand all instructions before attempting to install any Victaulic products. • Always verify that the piping system has been completely depressurized and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products. • Wear safety glasses, hardhat, and foot protection. <p>Failure to follow these instructions could result in death or serious personal injury and property damage.</p>
<ul style="list-style-type: none"> • These products shall be used only in fire protection systems that are designed and installed in accordance with current, applicable National Fire Protection Association (NFPA 13, 13D, 13R, etc.) standards, or equivalent standards, and in accordance with applicable building and fire codes. These standards and codes contain important information regarding protection of systems from freezing temperatures, corrosion, mechanical damage, etc. • The installer shall understand the use of this product and why it was specified for the particular application. • The installer shall understand common industry safety standards and potential consequences of improper product installation. • It is the system designer's responsibility to verify suitability of materials for use with the intended fluid media within the piping system and external environment. • The material specifier shall evaluate the effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on materials to confirm system life will be acceptable for the intended service. <p>Failure to follow installation requirements and local and national codes and standards could compromise system integrity or cause system failure, resulting in death or serious personal injury and property damage.</p>	

7.0 REFERENCE MATERIALS

Ratings: All glass bulbs are rated for temperatures from -67°F/-55°C.

[1-40: Victaulic FireLock™ Automatic Sprinklers Installation and Maintenance Instructions](#)

[1-V9: Style V9 Victaulic FireLock™ IGS™ Installation-Ready™ Sprinkler Coupling Installation Instructions](#)

User Responsibility for Product Selection and Suitability

Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

Intellectual Property Rights

No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be constructed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

Note

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

Installation

Reference should always be made to the Victaulic installation handbook or installation instructions of the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at www.victaulic.com.

Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

Trademarks

Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.